


LID SECURED BY 2 NO. SCREWS

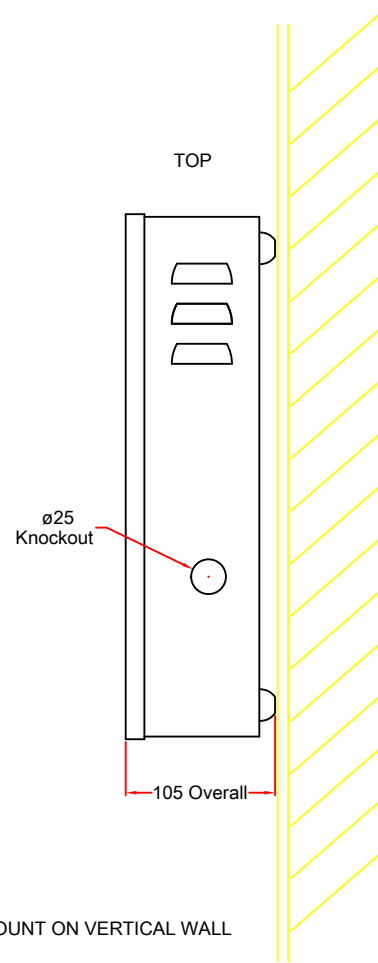

MOUNTING WALL

MOUNT ON VERTICAL WALL

IMPORTANT :-
 THE GROUP CONTROLLER'S POWER SUPPLIES COOLING RELIES ON NATURAL CONVECTION THROUGH THE CASE LOUVRES FOR CORRECT OPERATION THE POWER SUPPLY MUST BE MOUNTED AS SHOWN IN THIS INSTRUCTION, ALLOWING A MINIMUM FREE AIR CLEARANCE AROUND THE CASE OF 50mm

COLOUR : APPLIANCE WHITE [RAL9010]
 WEIGHT : (INCLUDING BATTERIES) 12 kg

REV A :- Updated Dimensions Added Cable Holes	REV B :-	REV C :-	REV D :-	REV E :-	SCALE NTS
DATE :- 13.08.2014	DATE :-	DATE :-	DATE :-	DATE :-	DISC NO.

DRAWN BY C. DAUBNEY	DATE 2 / 08 / 11
CHECKED BY D. NAYLOR	DATE 27 / 08 / 14

PROJECT	TITLE Standard BO 87 Cabinet Details
DRAWING NUMBER BLE-214	

SMOKE CURTAINS
 FIRE CURTAINS
 FIXED CURTAINS
 INSTALLATION
 COMMISSIONING
BLE
 MAKING BUILDINGS SAFER
 B.L.E. SMOKE & FIRE CURTAINS
 HEAD OFFICE SHEFFIELD
 TEL :- 0114 251 4703
 FAX :- 0114 251 3908
 email:- curtains@blegroup.co.uk